



Fire Marshal's Office
San Mateo County Fire
CAL FIRE

320 Paul Scannell Drive, San Mateo, California 94402 (650) 573-3846

Date: Dec. 13, 2011

Revised: Aug. 8, 2015


Number: *CFS-011*

Title: *Bollard/Guard Post*

Approved: *Mark Mondragon*

Bollard/Guard Post

Construction Guidelines:

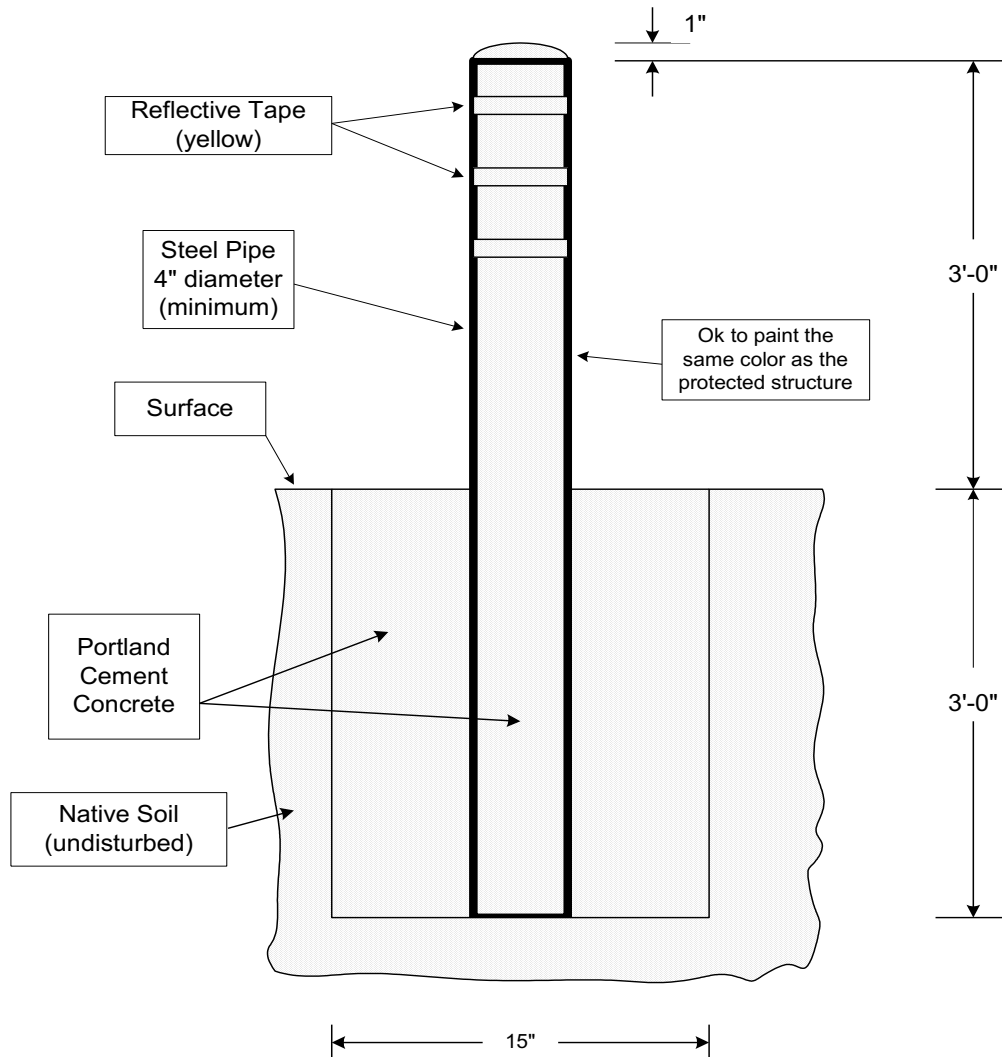

NOTE: Guard posts shall be spaced not more than 4' on center.

Guard post to be completely filled with concrete. 2016 CFC 312

Note: When protecting aboveground fuel tank, guard posts shall be a minimum of 3 feet from tank and painted yellow.